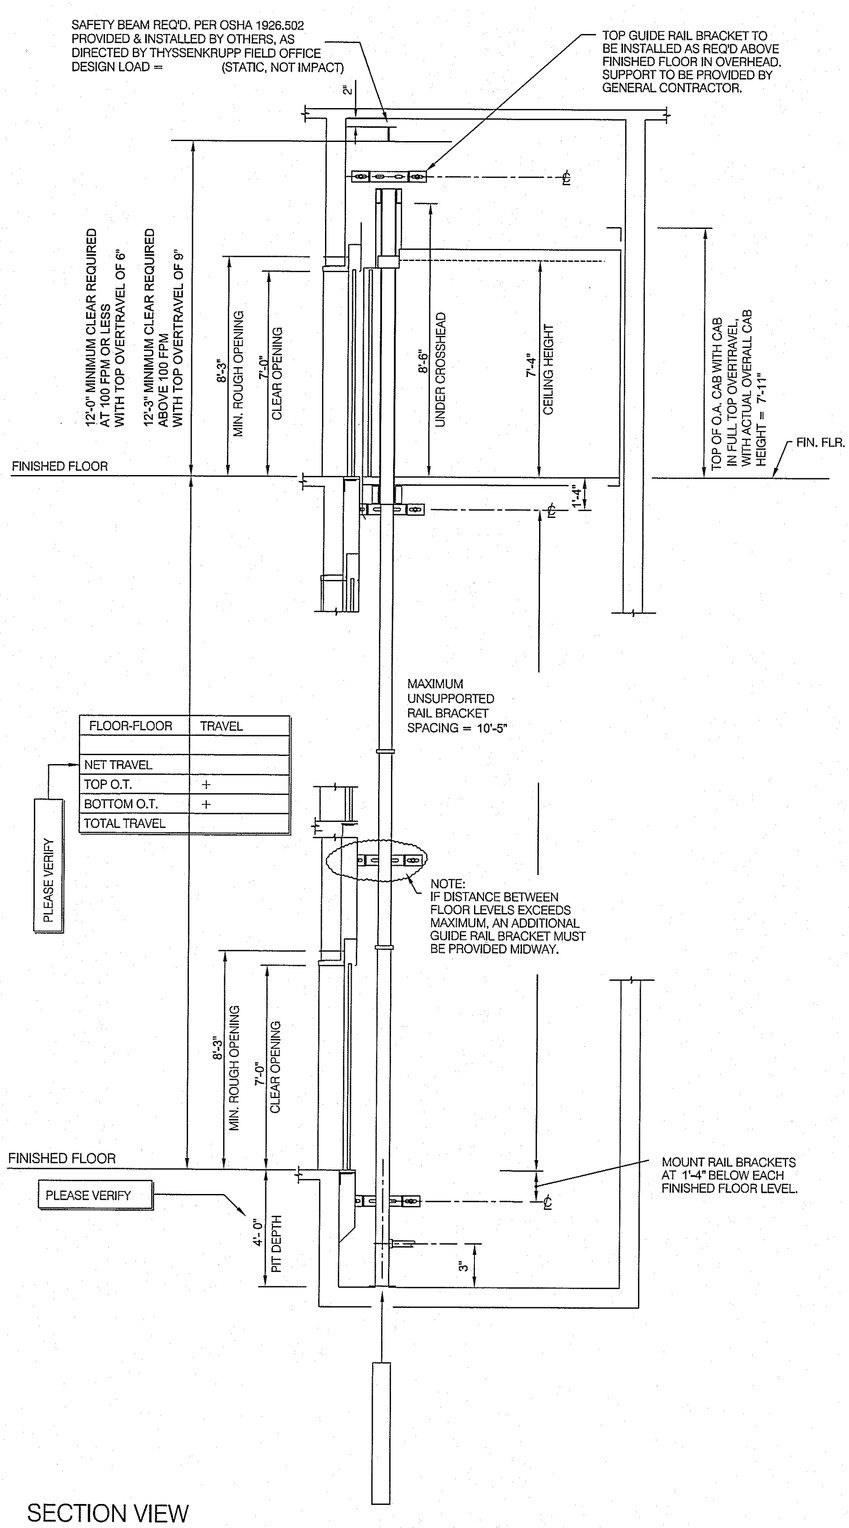

SECTION VIEW

NOT TO SCALE

PLEASE VERIFY WALL THICKNESS AND TYPE AT EACH LANDING		
FLR	THKNESS	WALL TYPE

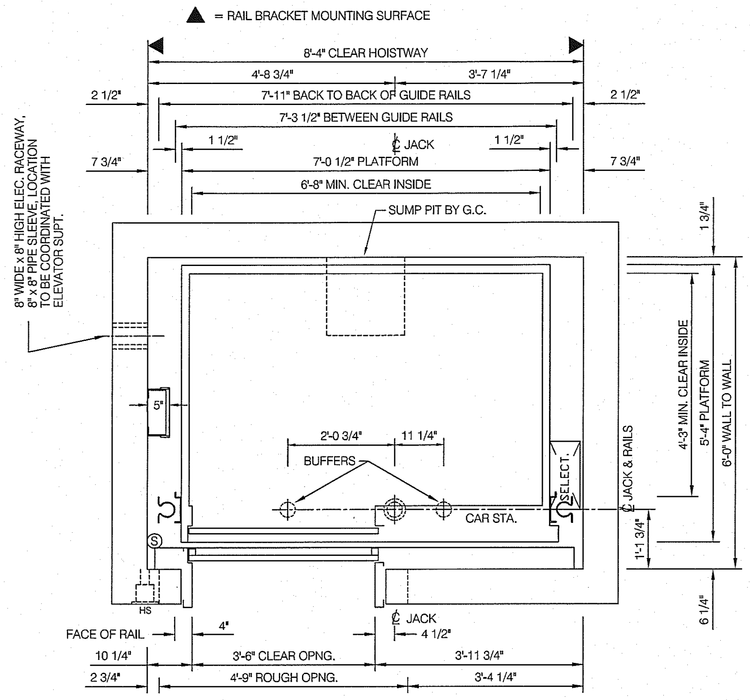

HOISTWAY PLAN

OILDRAULIC ELEVATOR CONTRACT DATA

TYPE: AMEE 25C HLS			ELEV #	
SPEED: FPM UP 150 FPM DOWN MAX.			CAPACITY: 2500	
OPERATION:				
CAR ENCLOSURE:				
DOOR TYPE: ONE SPEED - LEFT HAND				
PLATFORM THK: 3 3/8	FINISHED FLOOR:			
TELEPHONE:	PIT LADDER:			
POWER UNIT: HP	POWER SUPPLY:			
STARTING:	GLOPU:	GLOJ:		
JACK MODEL: TELE	OVERTRAVEL:	TOP	BOTTOM	
PLUNGER O.D.:	WALL THK:			
CYLINDER O.D.:	WALL THK:	NET AREA		
BOTTOM CAR RUNBY: 6"	CAR BUFFER STROKE: 2 1/2"			
BETWEEN PIT FLR. & CAR BOLSTER ON COMPRESSED BUFFER: 2'-4 1/8"				
BUFFER REACTION (TYP. AT EACH BUFFER) =				
EST. WORKING PRESS.				

THE FOLLOWING CONDITIONS MUST BE MET BEFORE INSTALLATION IS COMPLETED, AND ARE NOT INCLUDED IN THE ELEVATOR CONTRACT:

1. A PLUMB, PROPERLY VENTILATED HOISTWAY (ACCORDING TO CODE AND SIZES SHOWN).
2. ADEQUATE SUPPORT FOR JACK, GUIDE RAIL BRACKETS, AND BUFFERS (FOR REACTIONS SHOWN).
3. HOISTWAY BARRICADES AND ALL CUTTING AND PATCHING TO INSTALL HOISTWAY ENTRANCES, SILLS, HALL FIXTURES, OIL AND ELECTRIC LINES.
4. PIT LIGHTS AND SWITCH, CONVENIENCE OUTLETS WITH GFCI PROTECTION PER NEC, PIT LADDER PER CAR (ACCORDING TO CODE). NOTE: MUST BE CLEAR OF ALL ELEVATOR EQUIPMENT.
5. DEDICATED 120 VOLT, 15 AMP. SERVICE, ALONG WITH TELEPHONE CIRCUIT WHEN REQUIRED, TO TERMINALS OF EACH REQUIRED CONTROLLER (AS LOCATED ON PLAN VIEW) FOR THE FOLLOWING:
   - CAR LIGHT AND ALARM CIRCUIT WITH GFCI PROTECTION PER NEC
   - GROUP CONTROL WHEN REQUIRED
   NOTE: IF STANDBY POWER IS SUPPLIED TO ELEVATOR, CAR LIGHT AND ALARM CIRCUIT AND GROUP CONTROL SERVICE MUST BE STANDBY POWER BACKED.
6. BRANCH CIRCUIT CONDUCTOR SIZING, MATERIALS, AND INSULATION (INCLUDING BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE) TO COMPLY WITH ALL LOCAL ELECTRICAL CODES.
   _____ AMPS STARTING CURRENT WITH A MAX. ALLOWABLE VOLTAGE DROP OF 10%.
   _____ AMPS FULL LOAD CURRENT WITH A MAX. ALLOWABLE VOLTAGE DROP OF 5%.
   _____ AMPS RATED CURRENT WITH A MAX. ALLOWABLE VOLTAGE DROP OF 5%.

   POWER REQUIREMENTS STATED IN NOTE 6 VERIFIED BY:

   NOTE: ALSO, A FOURTH WIRE OF SAME SIZE AS THREE PHASE WIRES IS REQUIRED FOR GROUNDING PURPOSES TO MINIMIZE ELECTRICAL NOISE INTERFERENCE. THE GROUNDING WIRE MUST BE CONNECTED TO THE BUILDINGS ELECTRICAL SYSTEM GROUND.
   IF BATTERY OPER. LOWERING IS PROVIDED, A MECHANICAL AUX. CONTACT SHALL BE INSTALLED ON THE DISC SW. FOR EA. CAR. THE AUX. CONTACT SHALL BE CONFIGURED AS SPST AT 1A 110VAC (MIN). THE AUX. CONTACT SHALL BE OPEN WHEN THE DISC SW. IS IN THE OPEN POSITION. IF A SHUNT TRIP CIRCUIT BREAKER IS PROVIDED, AN AUX. CONTACT SHALL BE INSTALLED ON THE CIRCUIT BREAKER.

   GEN. CONTRACTOR MUST FORWARD POWER REQUIREMENTS TO ELEC. CONTRACTOR.
7. AN ENCLOSED MACHINE AREA (ACCORDING TO CODE), WITH ADEQUATE LIGHT, HEAT, AND VENTILATION (MIN. 50°F., MAX. 90°F. WITH NON-CONDENSING HUMIDITY OF 10-90%), AND SEALED CONCRETE FLOOR SLAB SURFACE.
   NOTE: MUST PROVIDE ADEQUATE DOOR SIZE TO ALLOW INSTALLATION OF EQUIPMENT, OR LEAVE WALL OUT UNTIL EQUIPMENT IS IN PLACE.
8. ENTRANCE WALL WITH LINTELS MUST BE PROVIDED AFTER ENTRANCE FRAMES ARE SET OR LEAVE A ROUGH OPENING 1"WIDER AND 1"HIGHER THAN THE FRAME OPENING. SEE INSTALLATION PROCEDURES FOR FRAME-TO-WALL INTERFACE DETAILS TO ENSURE CONFORMANCE WITH THE LABELED ENTRANCE INTERFACE CONSTRUCTION.
9. POCKETS IN CORRIDOR WALL (PER FIXTURE DRAWINGS) FOR HALL FIXTURES.
   NOTE: MUST BE LOCATED AS DIRECTED BY ELEVATOR CONTRACTOR
10. SMOKE SENSORS (AS REQUIRED).
11. CONDUIT AND WIRING FROM HOISTWAY TO ELEVATOR MONITORING PANELS (FOR SECURITY, LIFE, SAFETY, OR FIRE REQUIREMENTS).
12. PIPE SLEEVES, TRENCHING, AND BACK FILLING FOR OIL AND/OR CONDUIT LINES AS SHOWN OR LOCATED BY ELEVATOR CONTRACTOR.

CAR STATION:

CAR RIDING LANTERN:

RAIL FORCES	F1	F2		
F1 / F2 OMEGA RAILS	734 LBS.	924 LBS.		

DATE	SYM.	REVISION	BY	CHKD.

DESIGNED PER ASME A17.1 — DO NOT SCALE THIS DRAWING

FOR: — ELEV #

ADDRESS:

CITY:

ARCHITECT:

GENERAL CONTRACTOR:

ELEVATOR CONTRACTOR:

This drawing and all information thereon is the proprietary property of ThyssenKrupp Elevator and must not be made public or copied. This drawing is loaned subject to return on demand and is not to be used directly or indirectly in any manner detrimental to the interest of ThyssenKrupp Elevator.

NOTE A: OIL PIPE LINES AND FITTINGS SHALL BE PROPERLY SUPPORTED TO RELIEVE STRAIN.

NOTE B: ALL REACTIONS INCLUDE ALLOWANCE FOR IMPACT.

NOTE C: THYSSENKRUPP ELEVATOR TO BE NOTIFIED OF ANY CHANGE TO ELEVATOR HOISTWAY OR MACHINE ROOM DESIGN.

NOTE D: ELEVATOR DESIGN & FABRICATION BASED ON ESTIMATED CAB WEIGHT SHOWN. LAYOUT APPROVAL WILL BE CONSTRUED AS FINAL CAB WEIGHT, UNLESS OTHERWISE NOTIFIED.

ThyssenKrupp Elevator

DRAWN	DATE	CHKD.	BRANCH	JOB NUMBER	DRAWING NO.	REV.	SHEET NO.
				A25LHTELE1			1 OF 1

Note:
1. FOR REFERENCE ONLY.

6527 Point Twenty Two
Gainesville, Georgia 30506
Phone (678) 231-4050
E-Mail: cpdarch@bellsouth.net

THIS DOCUMENT IS THE PROPERTY OF DENNIS L DUBEY, ARCHITECT AND IS CONSIDERED AN INSTRUMENT OF SERVICE AND IS SOLELY FOR USE WITH RESPECT TO THE PROJECT AS INDICATED BELOW. ALL RIGHTS RESERVED. THIS DOCUMENT MAY NOT BE REPRODUCED OR BE USED ON ANY OTHER PROJECT EXCEPT BY WRITTEN AGREEMENT FROM THE ARCHITECT. THIS DOCUMENT IS NOT VALID FOR CONSTRUCTION UNLESS MARKED OTHERWISE.

NOT RELEASED FOR CONSTRUCTION

PROFESSIONAL SEAL

PROJECT LOCATION

3034 OLD ATLANTA ROAD
CUMMING, GA 30041

Montessori Kids Academy

REVISIONS

ELEVATOR PLAN, SECTIONS & DETAILS

DATE	PROJECT No.
8-17-09	29001

SHEET No.
A1.5